

Test Report No. 7191061185-MEC13/03-KSY
dated 17 JUN 2013



PSB Singapore

Note: This report is issued subject to the Testing and Certification Regulations of the TÜV SÜD Group and the General Terms and Conditions of Business of TÜV SÜD PSB Pte Ltd. In addition, this report is governed by the terms set out within this report.

SUBJECT:

Testing of Fibre Cement Board

TESTED FOR:

Visaka Industries Ltd
Visaka Towers
1-8-303/69/3, S.P. Road
Secunderabad
A.P 500003
India

ATTN: Mr Rawtani Jawahar

SAMPLES DESCRIPTION:

Twelve pieces of fibre cement board test specimens (typical as shown in Figure 1), each with approximate dimensions of 100 mm x 100 mm x 5 mm were submitted by Visaka Industries Ltd on 8 May 2013 for testing.

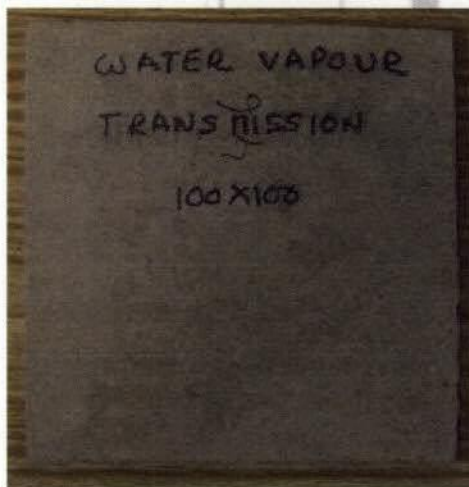


Figure 1a: Smooth Surface



Figure 1b: Rough Surface

Wah Yeh



TÜV SÜD PSB

Laboratory:
TÜV SÜD PSB Pte. Ltd.
No.1 Science Park Drive

Phone : +65-6885 1333
Fax : +65-6776 8670
E-mail: testing@tuv-sud-psb.sg

Regional Head Office:
TÜV SÜD Asia Pacific Pte. Ltd.
3 Science Park Drive, #04-01/05

Test Report No. 7191061185-MEC13/03-KSY
dated 17 JUN 2013



TEST METHOD (AS AGREED AND SPECIFIED BY THE CLIENT):

Water Vapour Resistance Factor

ISO 12572 : 2001

Hygrothermal performance of building materials and products - Determination of water vapour transmission properties

Method used : Desiccant
Nominal thickness : 5 mm
Test condition : 23 ± 0.5 °C, 50 ± 3 %RH
No. of determinations : 5

TEST RESULTS:

Characteristic	Unit	Results
Water Vapour Transmission, average	g/m ² ·day	40.6
	g/m ² ·hr	1.69
Permeance, average	g/Pa m ² ·s	3.35 x 10 ⁻⁷
Permeability, average	kg/Pa·m·s	1.68 x 10 ⁻¹²
Water Vapour Resistance Factor (μ), average	-	117

NOTE: As specified by the client, smooth surface of the fibre cement board was exposed to desiccant.

Ting Yeow Wah
Higher Associate Engineer

Kong Siew Yong
Senior Associate Engineer
Polymer Products
Mechanical Centre

Test Report No. 7191061185-MEC13/03-KSY
dated 17 JUN 2013



PSB Singapore

Please note that this Report is issued under the following terms :

1. This report applies to the sample of the specific product/equipment given at the time of its testing/calibration. The results are not used to indicate or imply that they are applicable to other similar items. In addition, such results must not be used to indicate or imply that TÜV SÜD PSB approves, recommends or endorses the manufacturer, supplier or user of such product/equipment, or that TÜV SÜD PSB in any way "guarantees" the later performance of the product/equipment. Unless otherwise stated in this report, no tests were conducted to determine long term effects of using the specific product/equipment.
2. The sample/s mentioned in this report is/are submitted/supplied/manufactured by the Client. TÜV SÜD PSB therefore assumes no responsibility for the accuracy of information on the brand name, model number, origin of manufacture, consignment or any information supplied.
3. Nothing in this report shall be interpreted to mean that TÜV SÜD PSB has verified or ascertained any endorsement or marks from any other testing authority or bodies that may be found on that sample.
4. This report shall not be reproduced wholly or in parts and no reference shall be made by the Client to TÜV SÜD PSB or to the report or results furnished by TÜV SÜD PSB in any advertisements or sales promotion.
5. Unless otherwise stated, the tests were carried out in TÜV SÜD PSB Pte Ltd, No.1 Science Park Drive Singapore 118221.

July 2011

